


REVISIONS					
REV. NO.	ZONE	DATE	ECN NO.	APPVD	DESCRIPTION
02	-	08/2005	DR1168	SH	REMOVED FV STRUT DETAIL
03	-	1/10/07	-	SH	DRAWING_CORRECTIONS

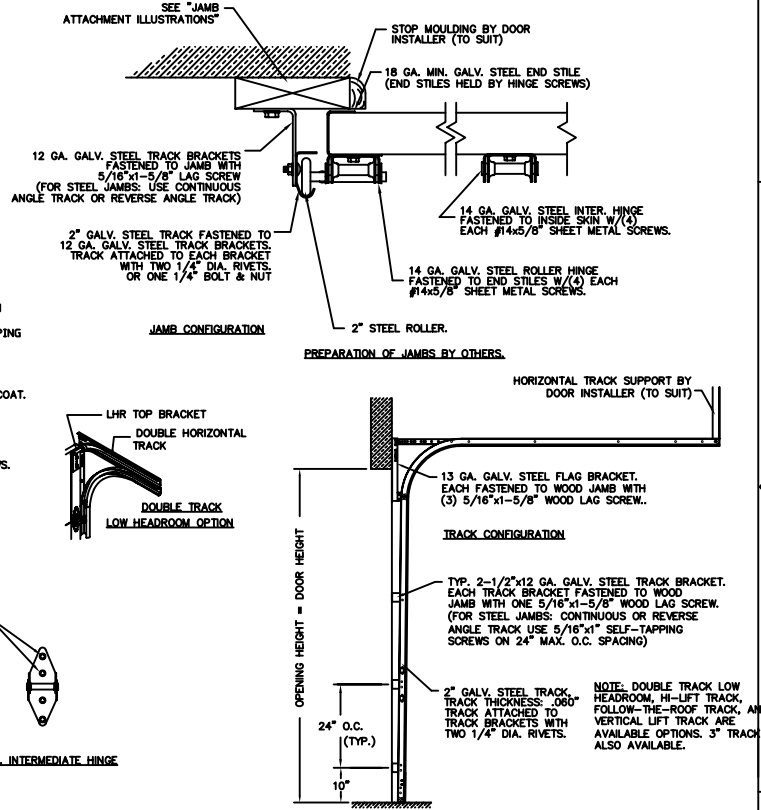

ANCHOR NOTE: FIRST (BOTTOM) ANCHOR STARTING AT NO MORE THAN HALF OF THE MAXIMUM ON-CENTER DISTANCE. HIGHEST ANCHOR INSTALLED AT LEAST AS HIGH AS THE DOOR OPENING.

<p><b>WOOD JAMB ON CONCRETE</b></p> <p>2,000 PSI MIN CONCRETE</p> <p>3/8" DIA. x 1-1/2" MIN. SLEEVE ANCHOR, WASHER INCL'D. 24" MAX. O.C. TO SECURE 2x6 JAMB TO CONCRETE. C'SINK IF NEEDED.</p> <p>12 GA. BRACKET MOUNT OR CONTINUOUS ANGLE MOUNT TRACK FASTENED TO 2x6 #2 OR BETTER YELLOW PINE JAMB WITH ONE 5/16"x1-5/8" LG. LAG SCREW PER BRACKET OR TRACK CLIP LOCATION.</p>	<p><b>CONCRETE JAMBS</b></p> <p>2,000 PSI MIN CONCRETE</p> <p>1/4"x1-1/2" MIN. EMBED SELF-TAPPING CONCRETE ANCHOR. 1" WASHER REQ'D. 24" MAX. O.C. TO SECURE ANGLE TO CONCRETE.</p> <p>REVERSE OR CONTINUOUS ANGLE MOUNT TRACK FASTENED DIRECTLY TO CONCRETE.</p>	<p><b>STEEL JAMBS</b></p> <p>3/16" MIN. STEEL JAMB</p> <p>1/4"x3/4" SELF TAPPING SCREW. 24" MAX. O.C. TO SECURE ANGLE TO STEEL JAMB.</p> <p>MAY BE BACK-FILLED WITH CONCRETE, BUT NOT REQUIRED FOR SELF TAPPING SCREW.</p> <p>12 GA. REVERSE OR CONTINUOUS ANGLE MOUNT TRACK FASTENED DIRECTLY TO STEEL JAMB.</p>	<p><b>WOOD JAMBS</b></p> <p>3/8"x1-1/2" MIN. EMBED LAG SCREW. 1-1/8" WASHER REQ'D. 24" MAX. O.C. TO SECURE 2x6 WOOD JAMB TO WOOD STRUCTURE. C'SINK IF NEEDED.</p> <p>12 GA. BRACKET MOUNT OR CONTINUOUS ANGLE MOUNT TRACK FASTENED TO 2x6 #2 OR BETTER YELLOW PINE JAMB WITH ONE 5/16"x1-5/8" LG. LAG SCREW PER BRACKET OR TRACK CLIP LOCATION.</p>
--	--	---	---

THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS IS THE RESPONSIBILITY OF THE BUILDING ENGINEER OR ARCHITECT OF RECORD.

Unless Stated Otherwise TOLERANCES are

.0	± .03
.00	± .015
.000	± .005
.0000	± .001
Degrees	± 1/2'

Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

**Glopay** Building Products Company

8585 Duke Boulevard Mason, OH 45040  
 Tel. No. 1-513-381-4800  
 Fax No. 1-513-762-3519

DESCRIPTION: MODEL 3300W1 14"WIDE

DRAWN BY: DAS DATE: 5/27/03 SCALE: NTS DWG. B

CHECKED BY: SH DATE: 08/28/03 SHEET 1 OF 1 SIZE B

DWG. NO.: 102889

MARK WESTERFIELD, P.E. FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513

DESIGN LOADS: +13.5 PSF & -13.5 PSF  
 TEST LOADS: +20.0 PSF & -20.0 PSF

PART NO.: CLOPAY WINDLOAD RATING W1

